



**GOVERNMENT OF TELANGANA  
TELANGANA DRINKING WATER SUPPLY PROJECT  
Rural Water Supply & Sanitation Department**

**TELANGANA WATER GRID**



**L&T Construction - Water, Smart World & Communication  
CHENNAI**

CLIENT: RURAL WATER SUPPLY AND SANITATION DEPARTMENT (WATER GRID), TELUNGANA.	CONSULTANT : WAPCOS LIMITED
--	--------------------------------

PROJECT :	PROVIDING DRINKING WATER TO HABITATIONS IN KOMARAMBHEEM ASIFABAD SEGMENT IN ADILABAD DISTRICT
-----------	---

SUPPLIER / CONTRACTOR:	L&T Construction, Water, Smart World and Communication
------------------------	--

JOB Ref. No. : LE150883	TITLE :																
<table border="1"><thead><tr><th></th><th>NAME</th><th>SIGN</th><th>DATE</th></tr></thead><tbody><tr><td>DSGN</td><td></td><td></td><td></td></tr><tr><td>CHKD</td><td></td><td></td><td></td></tr><tr><td>APPD</td><td></td><td></td><td></td></tr></tbody></table>		NAME	SIGN	DATE	DSGN				CHKD				APPD				<b>DESIGN OF SUMP - 10KL CAPACITY GODDIGUDAGUNTA AT INDERVELLY MANDAL</b>
	NAME	SIGN	DATE														
DSGN																	
CHKD																	
APPD																	

DOC./DRG. No.	SIZE	REV.																								
<table border="1"><tr><td>L</td><td>E</td><td>1</td><td>5</td><td>0</td><td>8</td><td>8</td><td>3</td><td>-</td><td>C</td><td>-</td><td>W</td><td>S</td><td>-</td><td>R</td><td>W</td><td>-</td><td>D</td><td>C</td><td>-</td><td>1</td><td>4</td><td>4</td><td>4</td></tr></table>	L	E	1	5	0	8	8	3	-	C	-	W	S	-	R	W	-	D	C	-	1	4	4	4	A4	A
L	E	1	5	0	8	8	3	-	C	-	W	S	-	R	W	-	D	C	-	1	4	4	4			

RELEASED FOR	<input type="checkbox"/> PRELIMINARY	<input type="checkbox"/> INFORMATION	<input checked="" type="checkbox"/> APPROVAL	<input type="checkbox"/> CONSTRUCTION
--------------	--------------------------------------	--------------------------------------	--	---------------------------------------

**Submitted sir,**

**Sub:**RWS&S-TDWSP- Vadoni 10KL clear water sump in Indervelly Mandal–Komarambheem Asifabad Segment-Adilabad District-Designs -Approval-Reg.

\*\*\*\*\*

Kindly puruse the Designs of the following 10KL Clear Water sump at Goddigudagunta(V), Indervelly(M), submitted by the Executive Engineer TDWSP Asifabad Division, Adilabad district for approval.

### 1. 10KL Clear Water Sump.

The Executive Engineer TDWSP Asifabad Division has submitted Structural Designs & Drawings of 10KL Clear Water sump based on the field conditions and as per the estimate provisions, the structural designs & drawings for the above structure is verified with RWS&S standard Type Designs and submitted for approval.

The following design parameters were considered:

- Capacity : 10KL
- Net SBC of Soil : 10.0 t/sqm
- Grade of concrete & Steel : M 30 & Fe 500
- Dia of sump Inner to Inner : 3 .00m
- Sidewall Height : 1.90mts
- Sidewall Thickness: ~~200mm~~ *250mm*
- Top Slab thickness: 150 mm
- RaftSlab thickness: 200mm

As per the above parameters the structural design and drawings of the clear water sump is verified, as per similar Type designs available and approved by the RWS&S Department considering the SBC and type of soil, duly following IS codes, IS: 456-2000, SP:16, 34, IS:3370 and IS 1893-2002 (seismic codes).The sizes and steel proposed in the designs and drawings of all components are safe and sufficient.


The additional points noted after checking the designs are:

- Detailed Estimate of the Structure with these specifications has to be prepared and compared with the provision made in sanctioned estimate. Such that deviation if any is within authorized limits. If any deviations noticed, the Estimate should be submitted for obtaining approval from the Competent Authority.

Subject to approval a draft memo addressed to the EE, TDWSP Asifabad Division , for communicating approved Structure is put up for kind perusal and approval.

  
AEE (Designs)  
TDWSP, Nirmal Circle

  
DEE (Designs)  
TDWSP, Nirmal Circle

  
Superintending Engineer,  
TDWSP, Nirmal Circle

# **DESIGN CALCULATION**

## **PROJECT TITLE**

PROVIDING DRINKING WATER TO HABITATIONS  
IN KOMARAMBHEEM ASIFABAD SEGMENT  
IN ADILABAD DISTRICT (30 MLD WTP)

## **UNIT**

10 KL SUMP

DCI NO: - LE150883-C-WS-RW-DC-1442  
&  
LE150883-C-WS-RW-NU-1443

## **PRINCIPAL CLIENT**

RURAL WATER SUPPLY  
AND  
SANITATION DEPARTMENT,  
TELANGANA

## **CONTRACTOR**

L&T CONSTRUCTION  
WATER & EFFLUENT TREATMENT SBG

## DESIGN OF SUMP

### BASIC DATA

Diameter = 3 m  
Water depth = 1.6 m  
Free board = 0.30 m

### CAPACITY CHECK

Required capacity = 10 KL

Capacity of suction

Clear diameter = 3 – 2 x plaster thickness  
= 3 – 2 x 0.012  
= 2.976 m

Water depth = 1.6 m

Volume =  $(\pi * d * d / 4) * H$   
=  $(\pi * 2.976 * 2.976 / 4) * 1.6 = 11.13 \text{ m}^3$  (including dead storage)

Volume-Dead storage = 11.13-1.04 = 10.09

Net volume = 10.09 m<sup>3</sup> > 10 m<sup>3</sup> hence O.K.

ELEMENT:

Inside tank: (1) Cylindrical wall  
(2) Top Slab

SBC – 10 t/m<sup>2</sup>

GROUND WATER TABLE: NO GWT

SUMP : 10 KL			FORMULA	
PROJECT: PROVIDING DRINKING WATER TO HABITATIONS IN KOMARAMBHEEM ASIFABAD SEGMENT IN ADILABAD DISTRICT (30 MLD WTP)	SUMP AT	CLIENT	RURAL WATER SUPPLY AND SANITATION DEPARTMENT, TELANGANA	
	Different village	DATE	2/2/2016	REV
STRUCTURE	DESIGN CALCULATION FOR SUMP			0
<b>DESIGN CALCULATION DATA</b>				
<b>General Data</b>	Required Capacity of Sump	Sumpcap	10.000	m <sup>3</sup>
Location				
<b>Hydraulic Features</b>				
Ground Level	GL	0.00	m	
Dead Storage	Ds	0.15	m	
Free Board	FB	0.30	m	
Basic Shape :	Circular with flat slab			
	<b>Material Data</b>			
unit weight of concrete	uwc	25.000	kN/m <sup>3</sup>	
unit weight of water	uww	10.000	kN/m <sup>3</sup>	
unit weight of plaster	uwp	21.000	kN/m <sup>3</sup>	
	<b>load Data</b>			
live load at roof slab	lff	1.500	kN/m <sup>2</sup>	
Finish load	FI	1.000	kN/m <sup>2</sup>	
	<b>Geometry Data</b>			
Diameter	Dia	3.00	m	
Depth of tank above GL		0.90		
Depth of tank below GL		1.00		
Water depth : With Dead storage	Wd	1.60	m	
Top Slab thickness	Tsthk	0.150	m	
				As per tender Specification

Bottom slab thickness	Bsthk	0.200	m
plaster thickness	pt	0.012	m
<b>Permissible stress ( As per IS 456 &amp; IS 3370)</b>			
Concrete			
Concrete grade -FCK	fck	30	N/mm <sup>2</sup>
per. stress in con. for direct comp	fokc	8.0	N/mm <sup>2</sup>
per. stress in con in com.due to bending	fokbc	10.0	N/mm <sup>2</sup>
per. stress in con. for direct tension	fokt	1.5	N/mm <sup>2</sup>
per. stress in con. In ten due to bending	foktb	2.0	N/mm <sup>2</sup>
modulus of elasticity for container	em	2.74E+04	N/mm <sup>2</sup>
Reinforcement	fy	500445	N/mm <sup>2</sup>
per. Ten. str.- steel tension due to bending	fyc	130	N/mm <sup>2</sup>
per. Ten. str.- steel tension due to direct ten	fyuc	130	N/mm <sup>2</sup>
Modular ratio	md	9.33	
Dimension for minimum steel	Dmin	15.0	m
Mass & Wt relation factor	g	9.810	
<b>[A] CAPACITY OF CONTAINER</b>			
<b>Volume Calculation</b>			
Water Depth with Dead Storage	Wdd	1.600	
Inside Diameter		3.000	
Clear Inside Diameter without plaster	Diac	2.976	
total volume	vt	11.13	m <sup>3</sup>
dead storage	vdd	1.04	m <sup>3</sup>
net volume	vn	10.09	m <sup>3</sup> > 10.000 OK
<b>[B] TOP SLAB DESIGN</b>			
Concrete grade	Fck	30	N/mm <sup>2</sup>
Steel	Fy	415	N/mm <sup>2</sup>
Clear cover	Cv	45	mm
Slab Diameter	Lx	3.000	m
Slab type	St	1	Simply supported

Width	B	1000 mm
Depth	D	150 mm
Maximum Bar dia	Db	10 mm
Density of concrete	Wd	25 kN/m <sup>3</sup>
Loading		
Live load	LI	1.5 kN/m <sup>2</sup>
Finishing load	FI	1 kN/m <sup>2</sup>
CALCULATION		
Calculation of loading		
Self wt ( Dead load)	DI	3.75 kN/m <sup>2</sup>
Total Load	TI	6.25 kN/m <sup>2</sup>
Effective depth	De	100 mm
Bending Moment	Bm	1.758 kN-m
Modular ratio		9.33
K		0.42
j = 1-k/3		0.9
Ast		157.1 mm <sup>2</sup>
Provide : 10 dia - 200 c/c		
<b>[C] CYLINDRICAL WALL</b>		
inner diameter	cyid	3.000 m
top thickness	cytt	0.150 m
bottom thickness	cybt	0.150 m
Water depth	cyh	1.600 m
coefficient of constant height	cyc	0.000 m
free board		0.300 m
height of wall fir design	cyhh	1.600 m
increment in thickness	cyth	0.000 m
Hoop Force ; Wall free at Top and hinge at bottom condition		
F = coe x H x D / 2		
F= Hoop force		

H = Height of water above that section  
 D = Diameter of wall at that section

Ration  $H^2/DT$  5.689  
 Enter Value for Auto serach 8.000

h

hoop force

sr. no	depth from top in meter	thickness at section	coefficient	hoop force in wall = Coe. X rad * height * unit wt of liquid	area of steel required / 1300 force / 1300	actual tensile stress in concrete = force/(thk*wid th+m*ast)	Minimum Area of steel in mm2 on each face
sr. no	area of steel requd	dia of bar	bar spacing	area of steel prod			
1	0.160	0.150	0.010	0.2	2	0.002	180
2	0.320	0.150	0.106	2.6	20	0.016	180
3	0.480	0.150	0.227	5.4	42	0.035	180
4	0.640	0.150	0.347	8.3	64	0.053	180
5	0.800	0.150	0.465	11.2	86	0.071	180
6	0.960	0.150	0.565	13.6	104	0.087	180
7	1.120	0.150	0.632	15.2	117	0.097	180
8	1.280	0.150	0.631	15.2	117	0.097	180
9	1.440	0.150	0.533	12.8	98	0.082	180
10	1.600	0.150	0.317	7.6	58	0.049	180
1	180.000	10	200	785			
2	180.000	10	200	785			
3	180.000	10	200	785			
4	180.000	10	200	785			
5	180.000	10	200	785			
6	180.000	10	200	785			
7	180.000	10	200	785			
8	180.000	10	200	785			
9	180.000	10	200	785			
10	180.000	10	200	785			

Minimum % steel as per IS 3370-2009

Maximum Dimension 3.000

Permissible dimension for 0.24 % steel 15.000

Minimum Steel 0.240

weight of wall		cyspw		59.4		kN		=Pl()* (cyid+cytt)* cyh*cytt* uwc	
straight part		cytpw		0.0		kN		=Pl()* (cyid+cytt+(cybt-cytl)/3)*cyh*(1-cyc)* (cybt-cytl)/2* uwc	
tapered part		cyppw		4.5		kN		=(cyid-pt)*Pl()*pt*(trdd+cyh+mrrdd/2-cyxa)* uwp	
plaster		tlcy		63.9		kN		=cyspw+cytpw+cyppw	
total weight									
Maximum moment in wall									
	sr. no	depth from top in meter	thickness at section	coefficient	moment in wall = Coe. X height^3 * unit wt of liquid	effective depth	Area of steel		
							required	Minimum	
		m	m		kn-m	m	in mm2	in mm2	
Minimum % steel as per IS 3370-2009	1	0.160	0.150	0.00013	0.005	0.095	0	180	
	2	0.320	0.150	0.00046	0.019	0.095	2	180	
	3	0.480	0.150	0.00105	0.043	0.095	4	180	
Maximum Dimension	4	0.640	0.150	0.00221	0.091	0.095	8	180	
#REF!	5	0.800	0.150	0.00364	0.149	0.095	13	180	
Permissible dimension for 0.24 % steel	6	0.960	0.150	0.00500	0.205	0.095	18	180	
15.000	7	1.120	0.150	0.00535	0.219	0.095	20	180	
Minimum Steel	8	1.280	0.150	0.00287	0.118	0.095	11	180	
#REF!	9	1.440	0.150	-0.00463	-0.190	0.095	-17	180	
	10	1.600	0.150	-0.01979	-0.811	0.095	-73	180	
	sr. no	area of steel reqd	dia of bar	bar spacing	area of steel prod	distance			
	1	180.000	10	200	393	0.160			
	2	180.000	10	200	393	0.320			
	3	180.000	10	200	393	0.480			
	4	180.000	10	200	393	0.640			
	5	180.000	10	200	393	0.800			
	6	180.000	10	200	393	0.960			
	7	180.000	10	200	393	1.120			
	8	180.000	10	200	393	1.280			
	9	180.000	10	200	393	1.440			
	10	180.000	10	200	393	1.600			
Vertical steel									
as compression only, I provide min r/f		0.240	%						
area of steel required total on both face		3.600	cm2						

## FOUNDATION DESIGN

### WALL FOOTING DESIGN

PROJECT: ADILABAD W.S.S

P16-2

UNIT : 10 KL Sump

WALL TYPE 1

W1

#### BASIC DATA

Density of water	denwt	10	kN/m3	
Density of soil	denso	18	kN/m3	
Density of concrete	decon	25	kN/m3	
Angle of Repose	Phi	30	degree	
Safe bearing capacity of soil	Sbc	100.0	kN/m2	
Concrete grade	Fck	30	N/mm2	
Steel grade	Fy	415	N/mm2	
Depth below Gl	Dbg	1.00	m	
Water depth	wtd	1.60	m	
free board	fb	0.30	m	
Wall above Ground		0.90	m	
Clear cover	Cv	50	mm	
Maximum size of bar dia	Db	12	mm	
Water depth with free board	Wd	1.90	m	
minimum % steel	pt	0.24	%	
Moment				
Due to Water	Mtw	1.00	kN-m	( From Analysis Result)
Wt from top dome/slab/column/wall	Slabwt	5.00	kN-m	

#### Wall geometry

Straight portion	lb	1.900	m
Tapered portion	lc	0.000	m
	tb	0.150	m
	td	0.150	m
Footing geometry			
Toe projection	ht	0.250	m
Heel straight projection	hh1	0.450	m
Heel tapered projection	hh2	0.000	m
Thickness at toe (free end)	tta	0.200	m
Thickness at toe (fwall face)	tth	0.200	m
Thickness at heel (wall end)	tha	0.200	m
Thickness at heel (freel face)	thb	0.200	m
Total Height of Wall	Tlw	1.900	m
Total length of wall footing	wf	0.850	m



### Design of Toe - At Point A

Moment at face of outer wall			
Due to rectangle diagram	Mreco	0.97	kN-m
	Mtrio	0.05	kN-m
Total moment due to upward pressure		1.02	kN-m
Net moment at A from Toe side	Toem	1.02	kN-m
Thickness at toe		200	mm
Effective depth	DefToe	144	mm
Ast required =		60.61	mm <sup>2</sup>
Check for minimum steel			
top		240	mm <sup>2</sup>
bottom		0	mm <sup>2</sup>
Design Steel			
Main steel - Top		240	mm <sup>2</sup>
Main steel - bottom		61	mm <sup>2</sup>
Distribution steel - top		240	mm <sup>2</sup>
Distribution steel - bottom		0	mm <sup>2</sup>

### Design of heel : At point B & C

<b>Design at point B</b>			
Due to rectangle diagram (upward)	Mrecl	2.55	kN-m
	Mtril	0.15	kN-m
Total Upward moment		2.70	kN-m
Due to water (down ward)		1.92	kN-m
Net downward moment at B from heel side	heelm	0.77	kN-m
Thickness Provided		200	mm
	defheel	144	mm
Ast required =		46	mm <sup>2</sup>
Check for minimum steel - straight portion			
top		240	mm <sup>2</sup>
bottom		0	mm <sup>2</sup>
Design Steel			
Main steel - Top		240	mm <sup>2</sup>
Main steel - bottom		0	mm <sup>2</sup>
Distribution steel - top		240	mm <sup>2</sup>
Distribution steel -bottom		0	mm <sup>2</sup>

<b>Design at point C</b>			
Due to rectangle diagram (upward)	Mrecl	0.00	kN-m
	Mtril	0.00	kN-m
Total Upward moment		0.00	kN-m
Due to water (down ward)		0.00	kN-m
Net downward moment at B from heel side	heelm	0.00	kN-m
Thickness Provided		200	mm
	defheel	144	mm
Ast required =		0	mm <sup>2</sup>
Check for minimum steel - tapered portion			
Average thickness	thav	0.20	m
top		240	mm <sup>2</sup>
bottom		0	mm <sup>2</sup>
Design Steel			
Main steel - Top		240	mm <sup>2</sup>
Main steel - bottom		0	mm <sup>2</sup>
Distribution steel - top		240	mm <sup>2</sup>
Distribution steel -bottom		0	mm <sup>2</sup>

**SUMMARY**

**Pressure Check**

1>	P/A + M/Z	33.5	<	100	OK
2>	P/A - M/Z	25.2	>	0	OK

**Reinforcement**

	AstR					Astp	
<b>Toe</b>		dia	spc	+	dia	spc	
Top - main	240	10	200	0	0	393	OK
Bottom main	61	10	200	0	0	393	OK
Top - Dist	240	10	200	0	0	393	OK
Bottom - Dist	0	10	200	0	0	393	OK
<b>Heel Straight portion</b>							
Top - main	240	10	200	0	0	393	OK
Bottom main	0	10	200	0	0	393	OK
Top - Dist	240	10	200	0	0	393	OK
Bottom - Dist	0	10	200	0	0	393	OK
<b>Heel tapered portion</b>							
Top - main	240	10	200	0	0	393	OK
Top - Dist	240	10	200	0	0	393	OK
Bottom - Dist	0	10	200	0	0	393	OK

*Yathred*

**Asst. Executive Engineer**  
TDWSP Asifabad

**Dy. Executive Engineer**  
TDWSP Asifabad

*Kare*

**Executive Engineer**  
TDWSP Asifabad

**APPROVED**







*M 6/4/14*  
**SE, NIRMAL**

NAME OF VILLAGE				
KOLAMGUDA	MADHARAMGUTTA	GOUNDUGUDA	GOVARGUDA	BABAPUR
DODDIGUEM	OTTIGHAT	NAYAKAPPUGUDA	GOTTIGOUNDUGUDA	PAVUGUDA
OOTPALLI	BHEEM GUDA	KONDI GG	SOMIGUDA	ALGUDA 3
NAYAKAPPU GUDA	PATHAGUDA	KANNEPALLY	RAJULAGUDA	KHILADIGAON

SCHEDULE OF PIPE	
INLET PIPE SIZE	-
OUTLET PIPE SIZE	-
OVER FLOW PIPE SIZE	-

- NOTES-**
- ALL DIMENSION ARE IN MM AND LEVELS ARE IN METER.
  - ALL CONCRETE MIX M-30 WITH MAXIMUM FREE WATER CEMENT RATIO OF 0.45 AND MAXIMUM CEMENT CONTENT OF 400kg/m<sup>3</sup> FOR WATER RETAINING STRUCTURE
  - ALL CONCRETE SHALL BE MACHINE MIXED AND MACHINE VIBRATED
  - # = INDICATE HYSD-TMT BAR FE-415 GRADE 1 CONFORMING TO IS 1786-LATEST REVISION
  - CLEAR COVER TO MAIN STEEL 50mm IN BOTTOM SLAB & 25mm IN BEAM, TOP SLAB & WALL
  - FOUNDATION SHALL REST ON IN-SITU SOIL AND IT SHALL NOT BE ON FILLING MATERIAL I.E. MADE UP SOIL OR HIGHLY COMPRESSIBLE SOIL
  - BACK FILLING SHALL BE DONE IN WELL COMPACTED AND WELL WATER LAYER NOT EXCEEDING 150mm IN DEPTH
  - SBC CONSIDERED IN DESIGN IS 10 T/M<sup>2</sup> & NO GROUND WATER TABLE.
  - INLET & OVERFLOW PIPE SHALL BE DECIDED AS PER SITE CONDITION
  - LOCATION & LEVELS OF INLET, OUTLET & OVERFLOW PIPE SHALL BE VERIFY WITH ENGINEER INCHARGE BEFORE EXECUTION

LAP LENGTH SECHDULE	
DIA OF BAR	LAP LENGTH "L" IN mm
8	320
10	400
12	480
16	640
20	800
25	1000

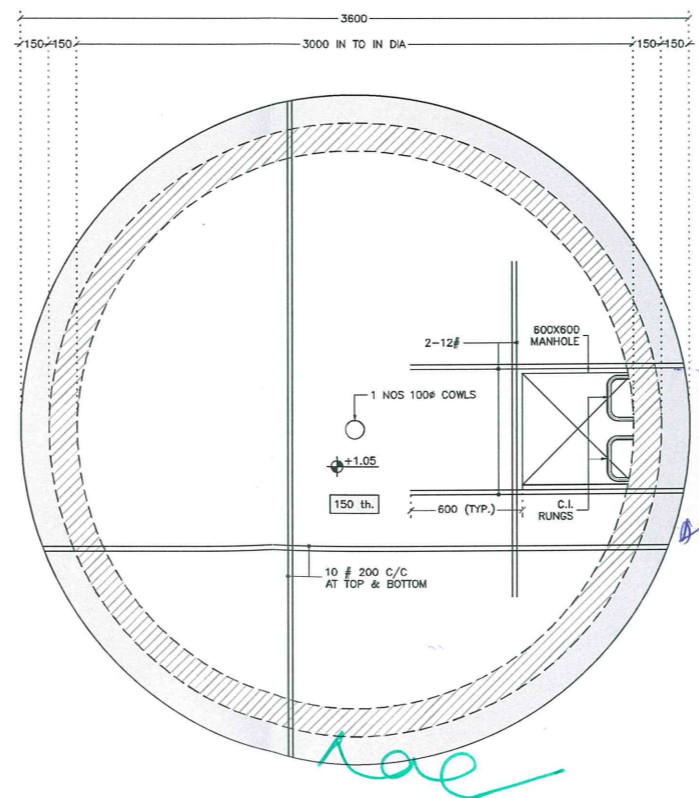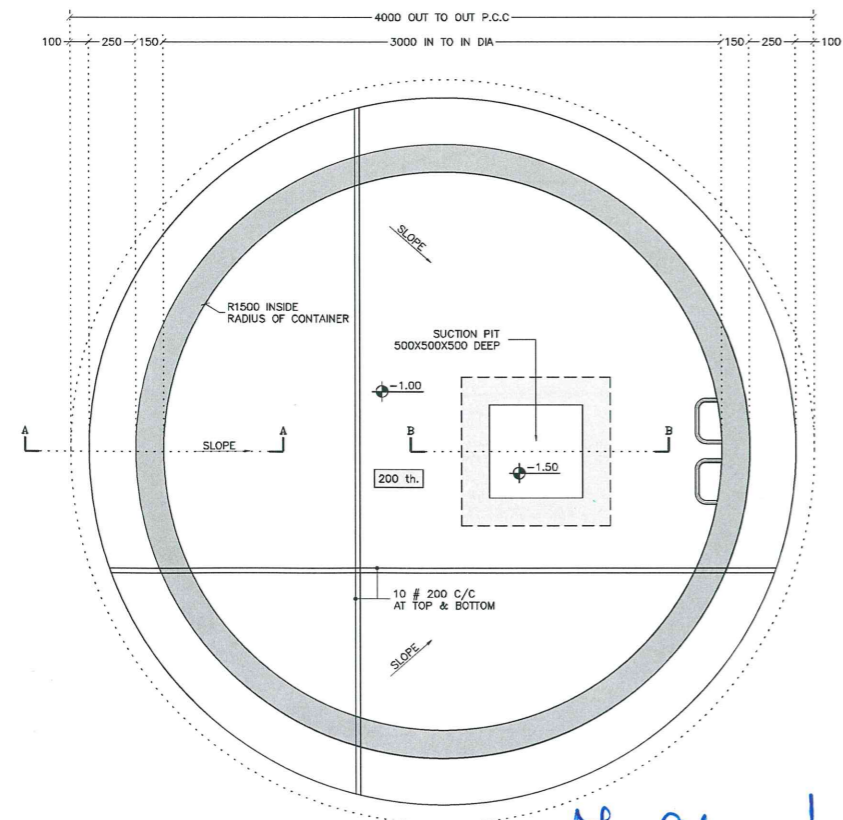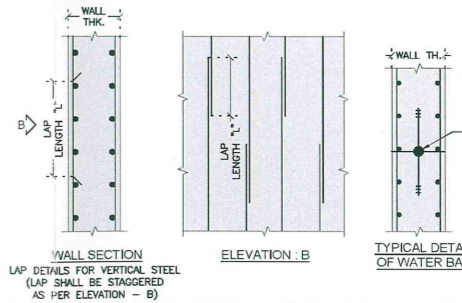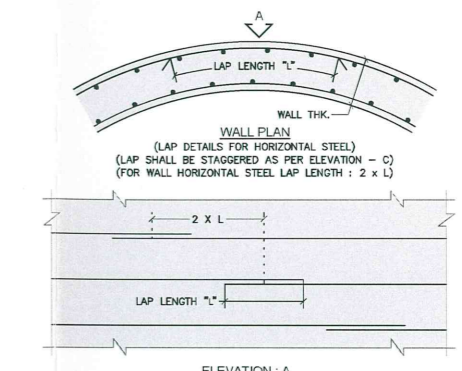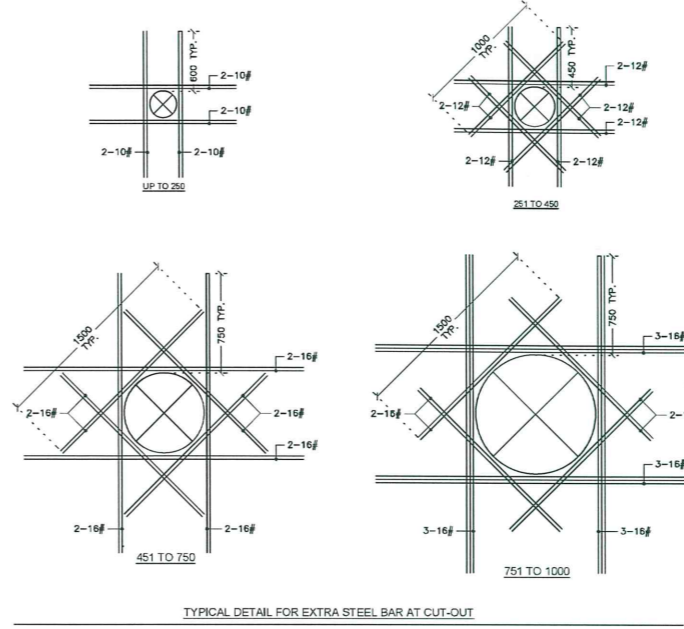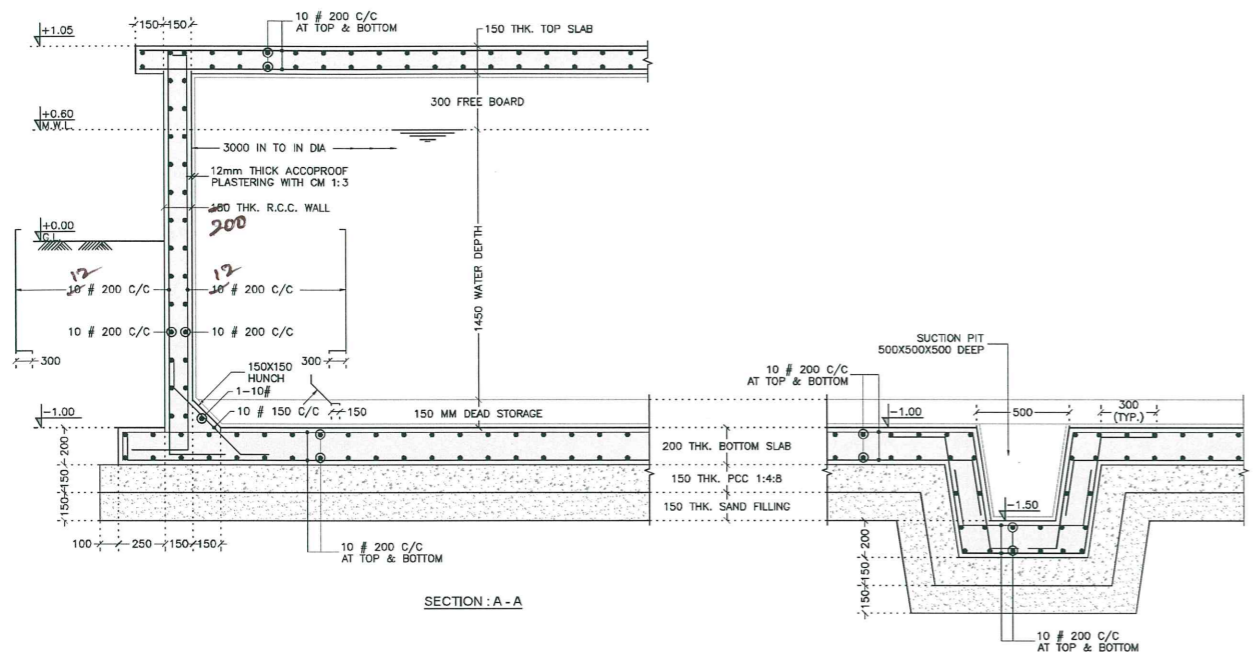

**APPROVED**  
M6/11/16  
SE, NIRMAL



REV. No	DESCRIPTION	DATE	DESIGNED	DRAWN	CHECKED	APPROVED
A	FOR APPROVAL	02/02/16	HMP	NSP	RMM	-

**REVISIONS**

**L&T Construction**  
Water, Smart World & Communication.

CLIENT: RURAL WATER SUPPLY AND SANITATION DEPARTMENT, TELANGANA. CONSULTANT: -

PROJECT: PROVIDING DRINKING WATER TO HABITATIONS IN KOMARAMBHEEM ASIFABAD SEGMENT IN ADILABAD DISTRICT

SUPPLIER / CONTRACTOR: **L&T Construction**  
Water & Effluent Treatment SBG

JOB No.: LE150883 TITLE: 10KL CAPACITY SUMP AT DIFFERENT VILLAGE (STRUCTURAL DETAILS) SCALE: 1:25

NAME	SIGN	DATE
DSGN	HMP	02-02-16
DRWN	NSP	02-02-16
CHKD	RMM	02-02-16
APPD	-	02-02-16




DRAWING No. LE150883-C-WS-RW-RC-14444  
COMP. DATE: P16-02-79-02-01 SHEET 1 OF 1

RELEASED FOR:  PRELIMINARY  TENDER  INFORMATION  APPROVAL  CONSTRUCTION

*Gautham*  
**Asst. Executive Engineer**  
TDWSP Asifabad

**Dy. Executive Engineer**  
TDWSP Asifabad

*Kae*  
**Executive Engineer**  
TDWSP Asifabad

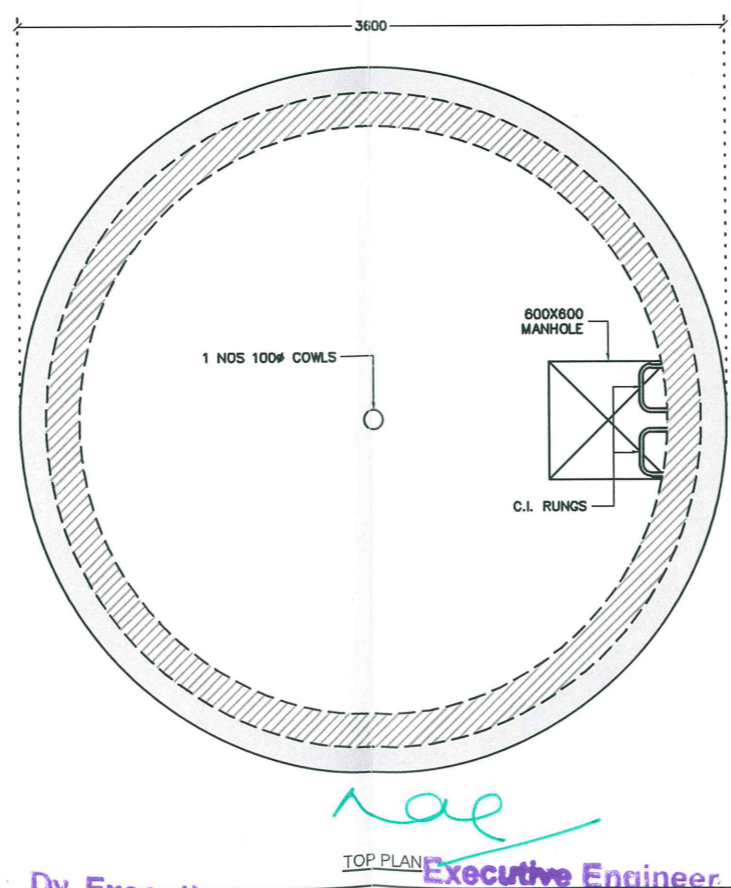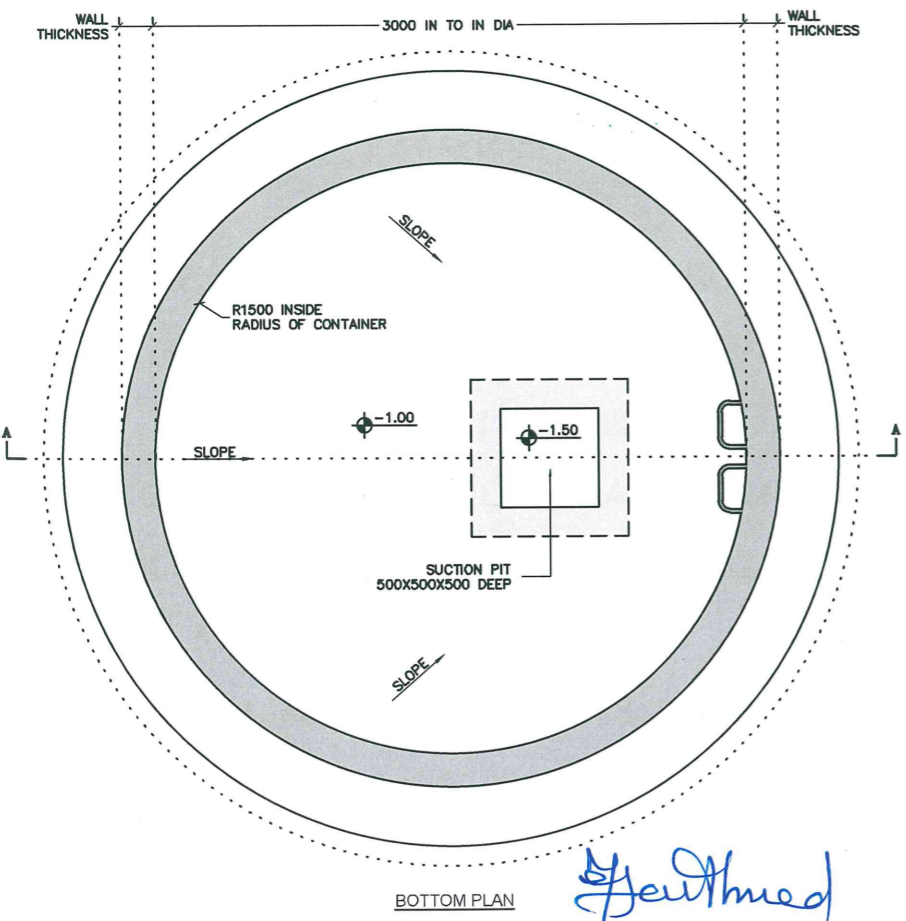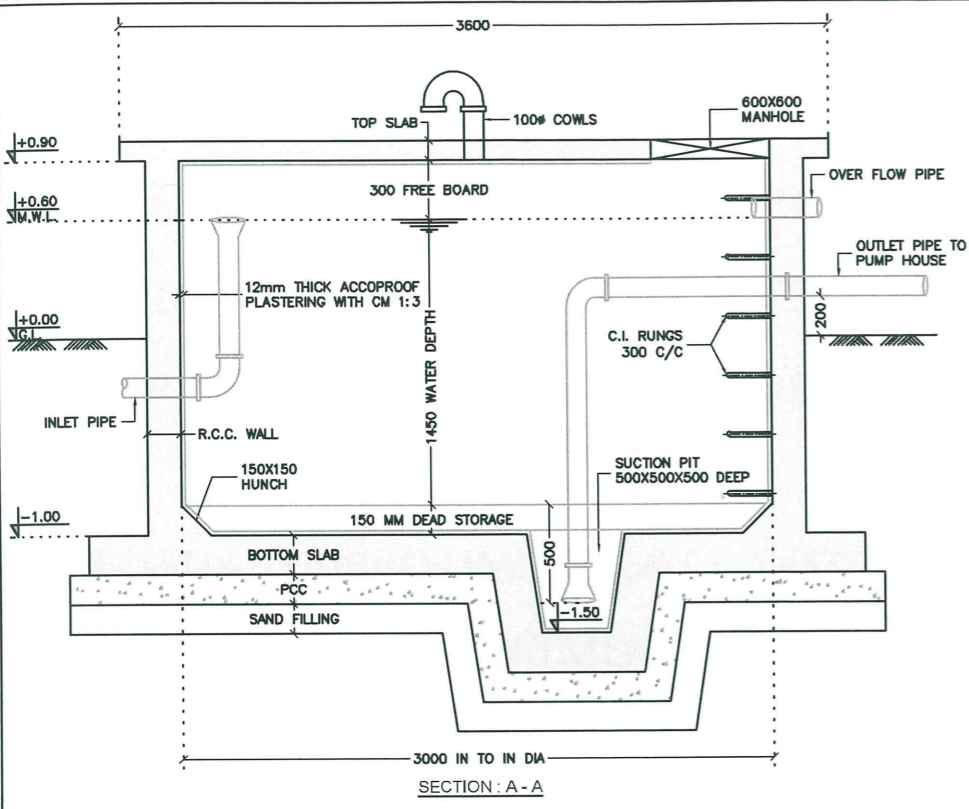

SCHEDULE OF PIPE	
INLET PIPE SIZE	-
OUTLET PIPE SIZE	-
OVER FLOW PIPE SIZE	-

NAME OF VILLAGE				
KOLAMGUDA	MADHARAMGUTTA	GOUNDUGUDA	GOVARGUDA	BABAPUR
DODDIGUEM	OTTIGHAT	NAYAKAPPUGUDA	GOTTIGOUNDUGUDA	PAVUGUDA
OOTPALLI	BHEEM GUDA	KONDI GG	SOMIGUDA	ALIGUDA 3
NAYAKAPPU GUDA	PATHAGUDA	KANNEPALLY	RAJULAGUDA	KHILADIGAON

NOTES :  
 <1> ALL DIMENSION ARE IN MM AND LEVELS ARE IN METER.  
 <2> LOCATION OF SUCTION PIT SHALL BE DECIDED AS PER SITE CONDITION BEFORE EXECUTION  
 <3> LOCATION & LEVELS OF INLET,OUTLET & OVERFLOW PIPE SHALL BE VARIFIED WITH ENGINEER INCHARGE BEFORE EXECUTION

APPROVED  
 P. G. 14/16  
 SE, NIRMAL



REV. No	DESCRIPTION	DATE	DESIGNED	DRAWN	CHECKED	APPROVED
A	FOR APPROVAL	02/02/16	-	PMD	RMM	-

**L&T Construction**  
 Water, Smart World & Communication.

CLIENT : RURAL WATER SUPPLY AND SANITATION DEPARTMENT, TELANGANA. CONSULTANT : -

PROJECT : PROVIDING DRINKING WATER TO HABITATIONS IN KOMARAMBHEEM ASIFABAD SEGMENT IN ADILABAD DISTRICT

SUPPLIER / CONTRACTOR : **L&T Construction**  
 Water & Effluent Treatment SBG

JOB No. : LE150883	TITLE : 10KL CAPACITY SUMP AT DIFFERENT VILLAGE (GENERAL ARRANGEMENT DRAWING)	SCALE : 1:30																			
<table border="1"> <thead> <tr> <th>NAME</th> <th>SIGN</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td>DSGN HMP</td> <td></td> <td>02-02-16</td> </tr> <tr> <td>DRWN PMD</td> <td></td> <td>02-02-16</td> </tr> <tr> <td>CHKD RMM</td> <td></td> <td>02-02-16</td> </tr> <tr> <td>APPD -</td> <td></td> <td>02-02-16</td> </tr> </tbody> </table>	NAME	SIGN	DATE	DSGN HMP		02-02-16	DRWN PMD		02-02-16	CHKD RMM		02-02-16	APPD -		02-02-16		<table border="1"> <thead> <tr> <th>SIZE</th> <th>REV.</th> </tr> </thead> <tbody> <tr> <td>A3</td> <td>A</td> </tr> </tbody> </table>	SIZE	REV.	A3	A
NAME	SIGN	DATE																			
DSGN HMP		02-02-16																			
DRWN PMD		02-02-16																			
CHKD RMM		02-02-16																			
APPD -		02-02-16																			
SIZE	REV.																				
A3	A																				

DRAWING No. LE150883-C-WS-RW-GA-1441  
 COMP. DATA : P16-02\_79-01-02 SHEET 2 OF 2

RELEASED FOR  PRELIMINARY  TENDER  INFORMATION  APPROVAL  CONSTRUCTION

Asst. Executive Engineer TDWSP Asifabad  
 Dy. Executive Engineer TDWSP Asifabad  
 Executive Engineer TDWSP Asifabad